



FOR FIRESTOP PIPES UP TO
MEDIUM DIAMETERS

ArmaProtect FC1

Firestop collar

Firestop collar for fire seals in walls and floors

// For sealing of combustible pipes without insulation up to 160 mm diameter

www.armacell.com



 **armacell**[®]
ArmaProtect[™]

ENHANCING SAFETY LEVELS TO PROTECT PROPERTY AND SAVE LIVES.

PASSIVE FIRE PROTECTION (PFP) products and systems are designed to provide fire-safe circumstances in the event of a fire emergency. Often built as part of the building component, PFP measures are not visible to building users and hence often overlooked as a fire protection measure.



PFP systems include:

// Building construction

- Fire protection to the load bearing structure
- The building envelope, e.g. fire rated external walls, curtain walls etc.

// Building services

- Firefighting shafts and stairwells
- Fire rated service ducts and shafts
- Fire rated cable coatings
- Fire rated elevators for emergency use only

// Ventilation systems

- Fire rated ductwork including fire dampers
- Fire rated air transfer grilles (mechanical or intumescent)

// Compartmentation

- Partitions and floors
- Fire rated doors
- Service shafts
- Suspended ceilings
- Fire rated glazing
- Fire shutters
- Industrial fire shutters and curtains
- Cavity barriers
- Linear gap seals
- Penetration seals for pipes, cables and other services, also known as firestop systems

COMPARTMENTATION

Regulated by building codes in many countries, buildings are sub-divided into "fire compartments" and in some cases also smoke compartments. In the event of a fire emergency in a building, the strategy is to keep the fire and smoke contained within a limited area of the building (the fire compartment) for a given amount of time (referred to as the fire rating). Fire ratings are country-dependent and typically ranges between 30 and 120 minutes (partly even up to 240 minutes).

Properly designed and installed, PFP systems complement fire compartments to provide multiple levels of fire safety, such as

- Providing building users sufficient time to safely make their way to a means of egress and escape from the building
- Keeping escape routes free from smoke and other toxic gasses, and
- Allowing emergency responders to safely rescue building users from the fire scene and attempt to extinguish the fire

Fire and flames cause severe harm but a key concern for humans is the inhalation of smoke and other toxic gasses. For example, if there is a hole



Compartmentation contributes to a holistic fire safety strategy, and firestop systems is an integral measure to be considered.

as small as 10 mm (0.4") in diameter penetrating a fire rated floor or ceiling between the two rooms and a fire is to occur in a room, it would take less than 3 minutes for the adjacent room to be filled with smoke. In this situation, you would not be able to see your own hand even if placed just 45 cm (18") in front of you. Incapacitation and physical impairment due to smoke inhalation occurs even faster.

Apart from being a safety issue for humans, smoke can also cause severe damage to assets and equipment, for example in hospitals and data centres.



BUILDINGS ARE EQUIPPED WITH MECHANICAL AND ELECTRICAL SYSTEMS TO PROVIDE COMFORT, SAFETY AND SECURITY. SERVICES CONNECTED TO THESE APPLIANCES RUN ACROSS BUILDINGS AND PENETRATE FIRE RATED WALLS, FLOORS AND SERVICE SHAFTS, COMPROMISING THE FIRE COMPARTMENTATION STRATEGY.

Firestop systems are designed to seal penetrations of such services, including:

- Insulated and non-insulated combustible pipes
- Insulated and non-insulated non-combustible pipes
- Single cables and cable bundles
- Cable trays

These systems should be tested according to local governing fire standards and installed in line with the details shown in the fire test report.

At Armacell, safety comes first and maximum reliability is essential. As a systems solutions provider, we know firestop system requirements and standards and offer global support. This table provides an indicative overview of fire test standards for firestop systems globally.

Standard	Description	Geographic coverage
EN 1366-3	Penetration seals	Europe
EN 1366-4	Linear joints	Europe
EN 13501-2	Fire classification of construction products and building elements	Europe
ISO 834	Fire resistance tests	Europe
UL 263	Fire tests of building construction and materials	Asia, Middle East, USA
UL 1479	Fire test of through-penetration firestops	Asia, Middle East, USA
UL 2079	Tests for fire resistance of building joint systems	Asia, Middle East, USA
ASTM E814-13	Standard test method for fire tests of penetration firestop systems	Asia, Middle East, USA



EUROPEAN STANDARDS

The European Standards applicable to firestop systems are EN1366-3, EN1366-4 and EN13501-2. Fire rating is measured as EI (integrity and insulation) for a specific time duration, and written as EI 60, EI 90, EI 120, EI 180 or EI 240.

- E rating (integrity, "E" from French "Étanchéité"): This is the ability of a test component to stop fire

from spreading to an unexposed side as a result of penetration of flames or smoke.

- I rating (insulation, "I" from French "Isolation"): This is the ability of a test component to restrict the temperature rise of the non-heated side to below specified levels during the fire, which is not more than +140 °C and up to +180 °C.

UL 1479 FOR THROUGH-PENETRATION FIRESTOPS

This method exposes test samples of penetration firestops to a fire for a standard period of time and temperature and to an application of a hose stream. Ratings are then established based on the length of time the firestop is able to resist before the first development of through-openings or flaming on the unexposed surface, the acceptable limitation of thermal transmission and acceptable performance under the application of the hose stream test.

Two ratings are established for each penetration firestop system:

- F rating (F = fire): based upon flame occurrence on the unexposed side of the test sample and acceptable hose stream performance
- T rating (T = temperature) based on temperature rise and flame occurrence on the unexposed side of the test sample and acceptable hose stream performance.

UL 2079 FOR FIRE RESISTANCE OF BUILDING JOINT SYSTEMS

These tests are applicable to joint systems of various materials and construction intended for use in linear openings between adjacent fire resistive structures. The fire endurance ratings for joint systems are intended to register performance during the period of fire exposure and are not intended to be interpreted as having determined the acceptability of the joint systems for use before or after fire exposure.

The intent of these methods is to develop data to assist others in determining the suitability of the joint systems where fire resistance is required. These requirements are intended to evaluate the length of time that the types of joint systems specified will contain a fire during a predetermined test exposure. The test evaluates the joint system's resistance to heat and, in some instances, to a hose stream, while carrying an applied load if the assembly is load bearing.

ARMAPROTECT FIRESTOP SOLUTIONS

ArmaProtect firestop systems:

- are easy to install and highly reliable.
- have been globally tested.
- are certified in numerous combinations and configurations, making the range a “one-stop-shop” solution
- are easy to inspect and to maintain.

Large,
global
approved
range

Excellent
fire
performance



ArmaProtect CM
Firestop mortar

Firestop mortar for mixed fire seals in walls and floors

- Blank openings
- Mixed and multiple services
- Cables, cable bundles and cable trays
- Conduit and conduit bundles
- Non-combustible and combustible pipes



ArmaProtect CB
Coated fireboard system with ArmaProtect ABLC Firestop coating and ArmaProtect ABLF Firestop filler mastic

Ablative coated board system for mixed fire seals in walls and floors

- Blank openings
- Mixed and multiple services
- Cables, cable bundles and cable trays
- Conduit and conduit bundles
- Non-combustible and combustible pipes



ArmaProtect CU
Firestop cushion

Firestop cushions for wall and floor openings

- Temporary or permanent sealing
- Cables and cable trays



ArmaProtect CT
Firestop cable tube

Cable tube for fire seals in walls and floors

- Blank openings
- Cables and cable bundles
- Conduit and conduit bundles
- Combustible pipes
- HVAC split-line combinations
- Ideally for retrofitting applications



ArmaProtect EXPS
Firestop sealant

Intumescent firestop sealant for mixed fire seals in walls and floors

- Blank openings
- Cables and cable bundles
- Conduit and conduit bundles
- Non-combustible and combustible pipes



ArmaProtect FW1
Firestop wrap

Firestop wrap for fire seals in walls and floors

- Cable bundles up to Ø150mm
- Combustible pipes up to Ø160mm



ArmaProtect FW2
Firestop wrap

Firestop wrap for fire seals in walls and floors

- Non-combustible pipes up to Ø323.9mm with combustible insulation
- Composite pipes
- Conduits and conduit bundles



ArmaProtect FW3
Firestop wrap

Firestop wrap for fire seals in walls and floors

- Combustible pipes Ø≤160mm (without combustible insulation)
- Combustible pipes Ø≤110mm (with combustible insulation)
- Multi-layer composite pipes Ø≤110mm



ArmaProtect FC1 and FC2
Firestop collar

Firestop collar for fire seals in walls and floors

For sealing of combustible pipes without insulation up to Ø160 mm (FC1) and Ø400 mm (FC2), respectively











ArmaProtect EFC1 and EFC2
Endless firestop collar

Endless firestop collar for fire seals in walls and floors








- Combustible pipes Ø≤ 160 mm (with and without sound insulation)
- Non-combustible pipes Ø≤ 108 mm (with combustible insulation)
- Multi-layer composite pipes Ø≤ 110 mm¹

SOLUTIONS WITH EN TESTING (ETA)

// For small to large openings
See relevant ETA for further installation details.










	SMALL	MEDIUM	LARGE
EXCEPTIONAL SOLUTION 	ArmaProtect CT <ul style="list-style-type: none">Pre-installed deviceClean installationEasy re-penetrationOpenings up to Ø116mmUp to EI 120 	ArmaProtect CB <ul style="list-style-type: none">Easy re-penetration and maintenanceCable, pipe, mixed and multiple penetrationsUp to EI 240Openings up to 1.4m x 2.0m or 1.2m x 2.4m, respectively 	
SUPERIOR SOLUTION 	ArmaProtect EXPS <ul style="list-style-type: none">Up to EI 120Openings up to Ø150mm  ArmaProtect ABLF <ul style="list-style-type: none">Up to EI 90Openings up to Ø160mm 		
STANDARD SOLUTION 		ArmaProtect CM <ul style="list-style-type: none">Cable, pipe, mixed and multiple penetrationsUp to EI 240Openings up to 1.2m x 2.0m 	

// For pipe penetrations
See relevant ETA for further installation details.




	SMALL TO MEDIUM PIPE DIAMETER	LARGE PIPE DIAMETER
EXCEPTIONAL SOLUTION 	ArmaProtect EFC1 and EFC2 <ul style="list-style-type: none">Flexible and clean installationProblem solver for special applications on job siteCombustible pipes Ø≤ 160 mm (with and without sound insulation)Non-combustible pipes Ø≤ 108 mm (with combustible insulation)Multi-layer composite pipes Ø≤ 110 mmUp to EI 240 	ArmaProtect FC2 <ul style="list-style-type: none">Pre-formed productClean installationCombustible pipes Ø≤ 400mm (without insulation)Up to EI 120 
SUPERIOR SOLUTION 	ArmaProtect FC1 <ul style="list-style-type: none">Pre-formed productClean installationCombustible pipes Ø≤160mm (without insulation)Up to EI 240  ArmaProtect FW3 <ul style="list-style-type: none">Flexible and clean installationCombustible pipes Ø≤160mm (without combustible insulation)Combustible pipes Ø≤110mm (with combustible insulation)Multi-layer composite pipes Ø≤110mmUp to EI 120 	ArmaProtect FW2 <ul style="list-style-type: none">Flexible and clean installationNon-combustible pipes up to Ø323.9mm (with combustible insulation)Up to EI 120 

SOLUTIONS WITH UL TESTING (ACC. TO UL 1479 / ASTM E814)

// For small to large openings
See relevant UL systems for further installation details.


	SMALL	MEDIUM	LARGE
EXCEPTIONAL SOLUTION 	ArmaProtect CT <ul style="list-style-type: none">Pre-installed deviceClean installationEasy re-penetrationOpenings up to Ø116mmUp to 3 h F rating 	ArmaProtect CU <ul style="list-style-type: none">Pre-formed productClean installationEasy re-penetrationFor temporary and temporary useOpenings up to 400mm x 200mmUp to 3 h F rating 	
SUPERIOR SOLUTION 	ArmaProtect FW1 <ul style="list-style-type: none">Flexible and clean installationCombustible pipes up to Ø160mmCable bundles up to Ø150mmUp to 3 h fire rating  ArmaProtect FW2 <ul style="list-style-type: none">Flexible and clean installationNon-combustible pipes up to Ø159mmComposite pipesConduits and conduit bundlesUp to 3 h fire rating 	ArmaProtect CB <ul style="list-style-type: none">Easy re-penetration and maintenanceAlso tested for bus bars and ductsUp to 3 h F ratingOpenings up to 0.6m x 0.4m 	
STANDARD SOLUTION 		ArmaProtect CM <ul style="list-style-type: none">Up to 3 h F ratingOpenings up to 0.6m x 0.4m 	

// For pipe penetrations
See relevant UL systems for further installation details.

	COMBUSTIBLE PIPES	NON-COMBUSTIBLE PIPES
SUPERIOR SOLUTION 	ArmaProtect FW1 <ul style="list-style-type: none">Flexible and clean installationCombustible pipes up to Ø160mmAlso tested for cable bundles up to Ø150mmUp to 3 h fire rating 	ArmaProtect FW2 <ul style="list-style-type: none">Flexible and clean installationNon-combustible pipes up to Ø159mmPE/AL/PE composite pipe up to Ø63mmAlso tested for PE-HD conduits up to Ø100mm (conduits Ø≤ 32mm), PE-HD conduits up to Ø50mm with speed pipe bundles and clima split bundlesUp to 3 h fire rating 

INSTRUCTIONS FOR USE

Ensure that surfaces are dry and free of dust and grease.

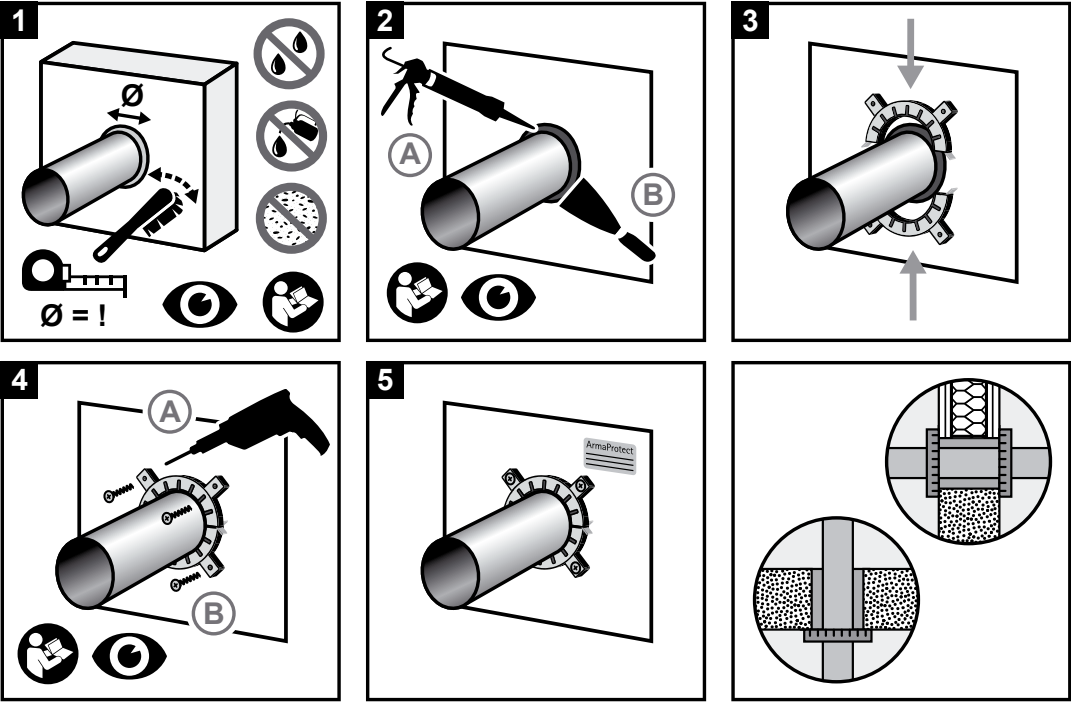

// Consumption guide

Choose ArmaProtect FC1 Firestop collar based on the pipe diameter.
Standard pipe application:

- 2 firestop collars for wall penetration (installation of firestop collar from both sides)
- 1 firestop collars for floor penetration (installation of firestop collar on the bottom side of the floor)

Collar size (Ø) [mm]	D2 (Internal Ø) [mm]	D1 (External Ø) [mm]	H1 (Installation height) [mm]	Number of hooks
50	52	61.2	42.5	2
63	65	78.2	42.5	3
75	77	90.2	42.5	3
90	92	109.2	42.5	3
110	112	129.2	42.5	3
125	127	148.2	42.5	4
140	142	167.2	42.5	4
160	162	187.2	42.5	4



MAIN APPLICATIONS
ACC. ETA-21/1024

In drywalls and solid walls ¹	
Base material	Drywall, concrete wall, aerated concrete wall, masonry wall
Base material thickness	≥ 100 mm
Maximum pipe diameter	up to 160 mm pipe diameter
Penetrants	up to EI 120-U/C ¹
• Combustible pipe without insulation (≤ 160 mm) ¹	

¹ See ETA 21/1024 for further installation details.


Concrete floors ¹	
Base material	Concrete floors
Base material thickness	≥ 150 mm (wall)
Maximum pipe diameter	up to 160 mm pipe diameter
Penetrants	up to EI 240-U/C ¹
• Combustible pipe without insulation (≤ 160 mm) ¹	

¹ See ETA 21/1024 for further installation details.




// Typical ETA approved systems¹

Wall application

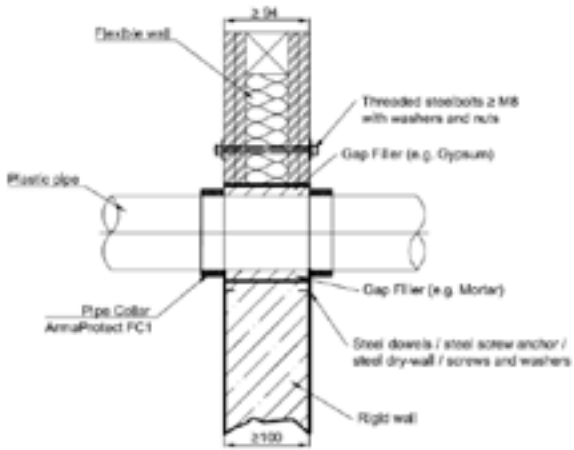

Floor application

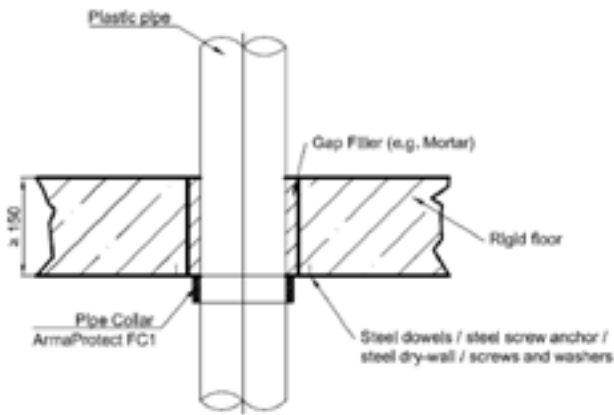

¹ See ETA 21/1024 for further installation details.

TECHNICAL DATA - ARMAPROTECT FC1 FIRESTOP COLLAR

Brief description	ArmaProtect FC1 is a solid metal sleeve equipped with several layers of intumescent material to maintain the fire resistance performance of fire penetrations in walls and floors.
Material type	Galvanized sheet steel housing with flexible intumescent strip.
Product colour range	Housing is silver grey and inlay is anthracite.
Special features	Easy visual inspection.
Product range	50mm to 160mm diameter.
Applications	Firestop collar for sealing combustible pipes without insulation.
Installation	For professional use only. Refer to third party published listings, national approvals / assessments and Armacell’s product literature for specific application details as well as before handling this product.
Declaration of Performance (DoP)	ArmaProtect FC1

Approvals and compliance

Specification compliance	<ul style="list-style-type: none">ETA 21 /1024 acc. EN 1366-3
--------------------------	---

Property	Value/Assessment	Standard/Test method
Temperature range		
Operating temperature	-40°C to 70°C (40°F to 158°F)	
Application temperature	5°C to 25°C (41°F to 77°F)	
Storage and transportation temperature	5°C to 25°C (41°F to 77°F)	
Mechanical properties		
Weight loss on heating	Inlay: 52 - 62% (at 550°C, 30 minutes)	EN 13501-1
Density	Inlay: 1.02 -1.42 g/cm³ (thickness 2 mm)	ETA 21/1024
Expansion ratio	Inlay: 12 - 22.5 times	ETA 21/1024
Expansion pressure	Inlay: > 0.6 N/mm²	ETA 21/1024
Fire performance		
Reaction to fire	Housing: Class A1 Inlay: Class E	EN 13501-1
Resistance to fire	See Annex	
Health and environment		
Emission of dangerous substances	No dangerous substances.	ETAG 026-02
Other technical features		
Durability and serviceability	Use category type Y ₁	EOTA TR 024
Safety information	Please refer to the safety data sheet available on our website.	
Storage	Store in a cool and dry place with an ambient temperature of 5 °C to 25 °C and protect from frost.	

Firestop collar

Item	Description	Content
PRO-FC1-050	ArmaProtect FC1 Firestop collar Ø 50 mm	1 piece(s)
PRO-FC1-063	ArmaProtect FC1 Firestop collar Ø 63 mm	1 piece(s)
PRO-FC1-075	ArmaProtect FC1 Firestop collar Ø 75 mm	1 piece(s)
PRO-FC1-090	ArmaProtect FC1 Firestop collar Ø 90 mm	1 piece(s)
PRO-FC1-110	ArmaProtect FC1 Firestop collar Ø 110 mm	1 piece(s)
PRO-FC1-125	ArmaProtect FC1 Firestop collar Ø 125 mm	1 piece(s)
PRO-FC1-140	ArmaProtect FC1 Firestop collar Ø 140 mm	1 piece(s)
PRO-FC1-160	ArmaProtect FC1 Firestop collar Ø 160 mm	1 piece(s)

Firestop wrap.

Item	Description	Content
PRO-ID-SET	ArmaProtect ID identification plate set	5 pieces

All data and technical information are based on results achieved under the specific conditions defined according to the testing standards referenced. Despite taking every precaution to ensure that said data and technical information are up to date, Armacell does not make any representation or warranty, express or implied, as to the accuracy, content or completeness of said data and technical information. Armacell also does not assume any liability towards any person resulting from the use of said data or technical information. Armacell reserves the right to revoke, modify or amend this document at any moment. It is the customer's responsibility to verify if the product is suitable for the intended application. The responsibility for professional and correct installation and compliance with relevant building regulations lies with the customer. This document does not constitute nor is part of a legal offer or contract. By ordering/receiving product you accept the Armacell General Terms and Conditions of Sale applicable in the region.

At Armacell, your trust means everything to us, so we want to let you know your rights and make it easier for you to understand what information we collect and why we collect it. If you would like to find out about our processing of data, please visit our Data Protection Policy.

© Armacell, 2022. All rights reserved. Trademarks followed by ® or ™ are trademarks of the Armacell Group.

00582 | ArmaProtect FC1 | ArmaProtect | PDS | 022022 | en-WW

ABOUT ARMACELL

As the inventors of flexible foam for equipment insulation and a leading provider of engineered foams, Armacell develops innovative and safe thermal, acoustic and mechanical solutions that create sustainable value for its customers. Armacell's products significantly contribute to global energy efficiency making a difference around the world every day. With more than 3,000 employees and 24 production plants in 16 countries, the company operates two main businesses, Advanced Insulation and Engineered Foams. Armacell focuses on insulation materials for technical equipment, high-performance foams for high-tech and lightweight applications and next generation aerogel blanket technology.



For more information, please visit:
www.armacell.com